

Removal of Natural Organic Matter (NOM), Turbidity, and Color of Surface Water by Integration of Enhanced Coagulation Process and Direct Filtration

Fallahizadeh Saeid,¹ Neamati Bahador,^{1*} Fadaei Abdalmajid,² Mengelizadeh Nezamaddin³

1. MSc. of Environmental Health Engineering, Shahrekord University of Medical Sciences, Shahrekord, Iran
2. Department of Environmental Health Engineering, School of Public Health, Shahrekord University of Medical Sciences, Shahrekord, Iran
3. Environment Research Committee, Isfahan University of Medical Sciences, Isfahan, Iran, Student Research Committee and Department of Environmental Health Engineering, School of Health, Isfahan University of Medical Sciences, Isfahan, Iran

Date of submission: 08 Dec 2016, **Date of acceptance:** 17 Jul 2017

ABSTRACT

This work assesses the efficiency of integrated enhanced coagulation and direct filtration processes for the removal of color, turbidity, and natural organic matter (NOM) from surface water. The processes were conducted in a simulated pilot. The operating conditions of the treatment process, including pH, FeCl₃ dose, and influent flow, were investigated. Following that, its efficiency was evaluated by measuring specific water quality parameters in the output stream including NOM, turbidity, and color. The results showed that under optimum conditions (pH, FeCl₃ dose, and influent flow of 6.2, 95 L/h, and 40 mg/l, respectively), the color and turbidity were removed 96% and 95% respectively. According to factors analysis by the Taguchi method, the influence of these factors on the removal of pollutants decreased as follows: pH > FeCl₃ dose > influent flow. The results revealed that the integrated enhanced coagulation process and direct filtration can improve the efficiency of colors, turbidity, and NOM removal in water treatment plants.

Keywords: Enhanced coagulation, Color, NOM, Turbidity, FeCl₃.

Introduction

Organic and mineral impurities like turbidity and color are major pollutants for aquatic environment pollution. The colloidal matter or turbidity is stable in an aqueous solution mostly because of the electrostatic repulsive force. Hence, it is not removed by sedimentation.¹ Natural organic matter (NOM) in aquatic environments can be derived from both natural and anthropogenic sources. However, its main source is terrestrial vegetation and soils.² The presence of NOM in surface water is not harmful. But problems arise when the source water containing NOM is treated with a disinfectant like chlorine. The

organic matter reacts with the chlorine and forms chlorination byproducts (CBPs) in the drinking water, such as haloacetic acids (HAAs) and trihalomethanes (THMs), which have been linked to dangerous diseases.³ In addition, NOM causes water to turn yellow, which is aesthetically unpleasant for consumers and is also the energy source for bacterial regrowth. Furthermore, NOM can facilitate the transportation of mineral and organic content in waterbodies due to humic complexation.⁴ To avoid these outcomes, it is necessary to decolorize water and remove these impurities before discharging surface water into the environment.

Different types of treatment are used in the removal of NOM, turbidity, and color from raw water; they consist of enhanced coagulation–flocculation–sedimentation,⁵ rapid sand filtration,⁶ adsorption,⁷ electro-coagulation,⁸ membrane filtration,⁹ and advanced oxidation.¹⁰

✉ Neamati Bahador
Neamatibahador@yahoo.com

Citation: Saeid F, Bahador N, Abdalmajid F, Nezamaddin N. Removal of Natural Organic Matter (NOM), Turbidity, and Color of Surface Water by Integration of Enhanced Coagulation Process and Direct Filtration. J Adv Environ Health Res 2017; 5(2): 108-113

Among these methods, enhanced coagulation and filtration are widely used in aqueous solution treatments as they are very effective to control a wide range of contaminants that include turbidity, NOM, color, algae, and inorganic substances. Moreover, the USEPA indicates that enhanced coagulation is the best available technology to control NOM and turbidity in drinking water treatment plants.¹¹ In recent years, instead of the conventional coagulation-flocculation method, these techniques were noticed to control color, taste and odour, known and unknown disinfection byproducts (DBPs), and micropollutants associated with NOM.¹² Furthermore, these methods have certain advantages such as relatively low costs, simple chemical reagents, and low capital cost, and they do not need monitoring of the breakthrough point.¹³

The enhanced coagulation and filtration processes normally consist of a coagulation process, a flocculation step, and a separation step such as direct filtration.¹¹ Enhanced coagulation is a physicochemical technique, which uses coagulant more for destabilizing and collecting or coagulating pollutants. The most common coagulants used in this process are aluminum sulfate (generally known as alum) and ferric chloride.¹⁴ Among these, ferric chloride (FeCl_3) is the most common coagulant used to achieve coagulation because of its relative solubility and high efficiency within the range of different pH levels. Mesdaghinia et al. (2006) studied the effectiveness of enhanced coagulation in the removal of disinfection byproducts. They reported that FeCl_3 was consistently more effective than $\text{Al}_2(\text{SO}_4)_3$ in removing NOM.¹⁵ Direct filtration is another process that improves the control of NOM as well as turbidity in water; it also provides optimum or near-optimum coagulation, with filtration conditions and management being in place.¹¹

Aligned to the objective of this research, the effects of variations, such as pH, FeCl_3 dose,

and influent flow on the removal pollutant, were investigated on a pilot scale.

Materials and Methods

In order to identify the optimum enhanced coagulation and direct filtration conditions for the treatment, experimental studies were conducted. Table 1 presents the characteristics of the water used during experimental works.

Table 1. Water quality studied characteristics

Parameter	Unit	Value
Color	Pt-co	140 ± 15
Turbidity	NTU	32 ± 6
pH	-	8.2 ± 0.4
Total Hardness	mg/l CaCO_3	382 ± 35
Alkalinity	mg/l CaCO_3	229 ± 35
Sulfate	mg/l	27 ± 9
Fe	mg/l	0.51 ± 0.1
Ca	mg/l	98 ± 10
Chloride	mg/l	59 ± 5
Manganese	mg/l	0.021 ± 0.015
Mg	mg/l	31 ± 4
Nitrate	mg/l	2.9 ± 0.5
Nitrite	mg/l	0.02 ± 0.01
Phosphate	mg/l	0.5 ± 0.2
EC	$\mu\text{S/cm}$	546 ± 56

The enhanced coagulation-direct filtration pilot plant was designed as a mixer with a two-layer filter that helped in the flocculation step. Fig. 1 shows the treatment process of enhanced coagulation with direct filtration on the pilot scale. The applied method was based on a two-stage operation. At first, ferric chloride was added to the contaminated water and the coagulation-flocculation action was carried out in the presence of coagulant. The next step involved direct filtration for the removal of clots from water. After performing the treatment process, turbidity, color, NOM, and pH of the samples were measured by TN-100 (EUTECH) turbidimeter, DR 5000-HACH LANGE, and pH-meter model CG 824 respectively.

To evaluate the effects of pH, FeCl_3 doses, and influent flow on the removal of turbidity, color, and NOM, data analysis and number reduction by design of experiments (DOE) were

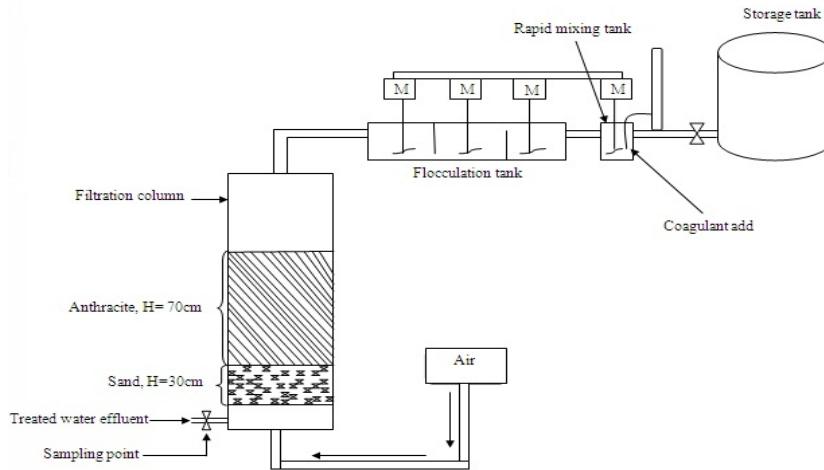


Fig. 1. A schematic of the pilot used in this study

carried out through software (Matlab software). The Taguchi plan was applied by three factors

at five levels (Table 2). The matrix involved 16 runs, and each run was triplicated.

Table 2. Analysis of variance for the effect coagulant dose, pH and flow rate on removal of color, turbidity and NOM

Parameter	Factor	df	F	Mean of variation	P	Impact	Rating
Color and Turbidity	Ferric chloride concentration (mg/l)	4	7.29	110.99	0.003	1.3	2
	pH	4	14.8	225.33	<0.001	1.57	1
	Flow rate	4	2	30.43	0.159	0.66	3
NOM	Ferric chloride concentration (mg/l)	4	91.79	275.647	<0.001	2.05	1
	pH	4	29.06	87.264	<0.001	1.20	2
	Flow rate	4	2.04	6.139	<0.152	0.26	3

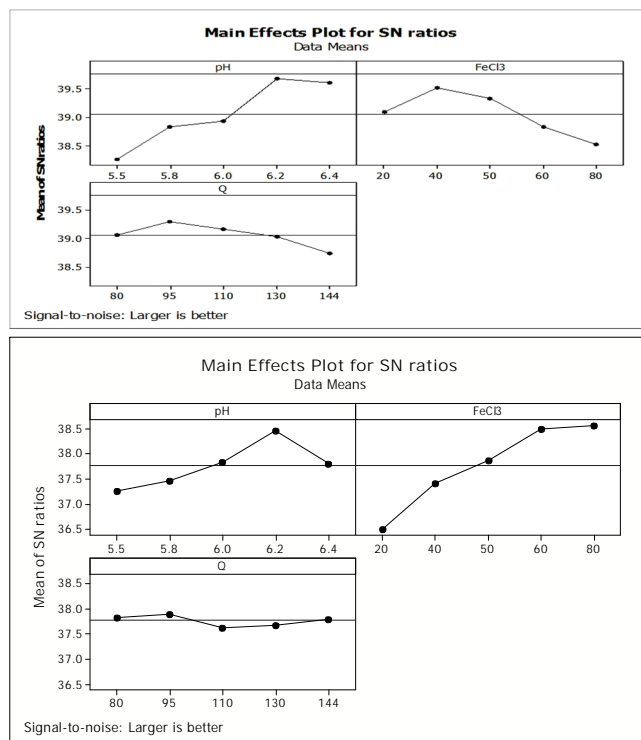


Fig. 2. The mean of signal to noise(S/N) of effluent for pH, coagulant dose and flow rate on the color and turbidity removal (a) and the NOM (b)

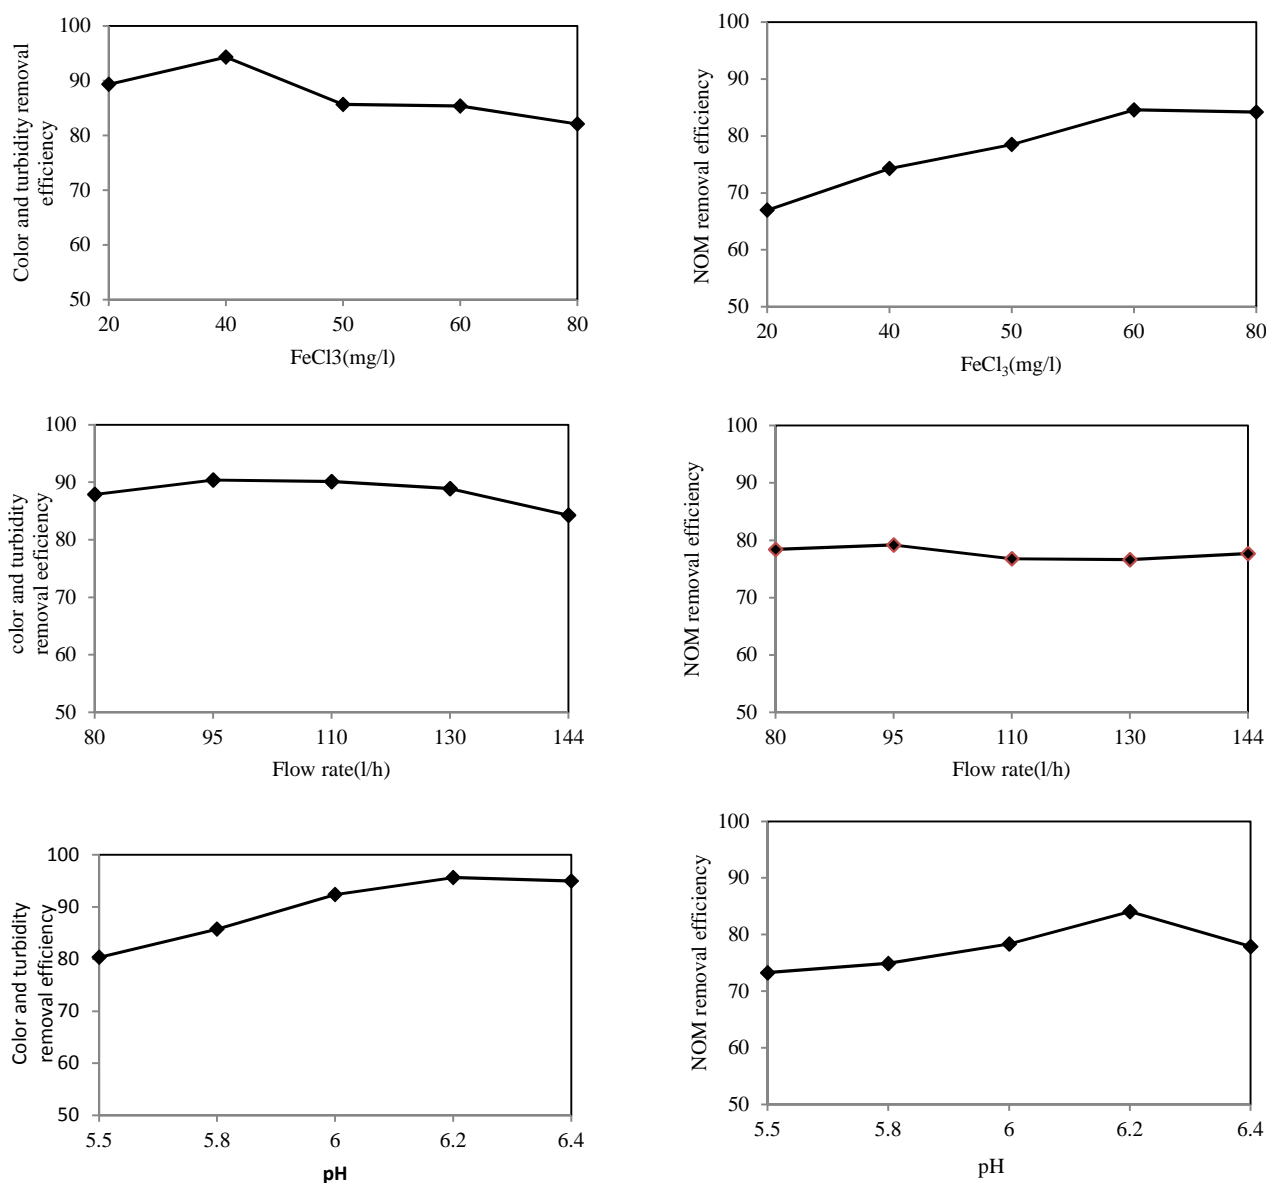


Fig. 3. The effect of changes pH, coagulant dose of Ferric chloride and influent flow on the color, turbidity and NOM removal efficiency

Results and Discussion

The efficiency of the removal of pollutants by enhanced coagulation and direct filtration processes depends on various factors such as pH, coagulant dose, and influent flow. In this study, the effect of these parameters was investigated on the performance of the enhanced coagulation process. Figures 2 and 3 present the efficiency of the removal of pollutants at various conditions. According to the figures, an increase in the pH level of the solution increases the efficiency of the removal of color, turbidity, and NOM. This increase of pollutant removal ratio

by FeCl₃ can be explained on the basis of groups formed through the hydrolysis of FeCl₃ in various pH levels. When ferric chloride is added to aqueous solutions, the lower pH of 8 is hydrolyzed to groups of Fe³⁺, Fe(OH)²⁺, Fe(OH)₃, and Fe(OH)₂⁺. Among these species of iron, Fe(OH)₂⁺ and Fe(OH)₃ represent more than 90% of the impurities at the intermediate pH values.¹⁶ Further in the intermediate pH range, the functional groups of NOM are partially ionized, yielding anionic species. Therefore, the charge neutralization/precipitation mechanism takes place through

chemical reaction between soluble humic anions and cationic species produced by ferric hydrolysis.¹⁷ Sperczyńska et al. studied the removal of turbidity and NOM from surface water by coagulation with polyaluminium chlorides (PACl). They reported that when pH decreased from 8.2 to 6.2, the effectiveness of organic compounds removal increased.¹⁸ Jaafarzadeh et al. studied the influence of polyaluminum chloride on the removal of heavy metal from aqueous solutions. The results showed that heavy metal removal is significantly enhanced by coagulation at high pH levels.¹⁴ The results obtained for NOM removal by Tubi et al. show that the greatest efficacy was achieved when PACl and FeCl_3 were applied in neutral pH.¹⁹

Fig. 3 shows the effect of FeCl_3 dose on the removal of pollutants. First, by increasing the FeCl_3 dosage, pollutant removal ratio is increased and then decreased. So the maximum removal percentage was about 94.3% and then 84.6% at coagulant dosage equal to 40 mg/L and 60 mg/L, respectively. This initial increase in the pollutant removal ratio can be attributed to the addition of FeCl_3 and an increase in $\text{Fe}(\text{OH})_2^+$ and $\text{Fe}(\text{OH})_3$ species. Further, by increasing the FeCl_3 dosage, coagulated pollutant becomes stable again, and returns to the solution. This explains the reduction in pollutant removal percentages at high dosages.¹⁴ Jaafarzadeh et al. obtained the same results and showed that by increasing PACl dosage, Zn and Ni removal ratio are increased and then decreased.¹⁴ Pang et al. studied the removal of lead, zinc, and iron from aqueous solution by aluminium sulfate (alum), polyaluminium chloride (PACl), and magnesium chloride (MgCl_2). Their results showed that the removal of heavy metal was reduced when the PACl dosage was increased to high level. This could be due to the restabilization of the colloidal particles in the presence of excess coagulant.²⁰ Fig. 3 also shows that the amount of pollutant removed increased and then decreased, when the flow rate was increased from 80 L/h to 144 L/h. This decrease can be related to the accumulation of flocs in pores of the filtration media. Bojic et al. reported that the amount of

copper removed increased, when the flow rate was increased from 1 L/min to 120 L/min.²¹

Analysis of variance (ANOVA) on the pH, flow rate, and coagulant concentration factors shows that the P-value was less than 0.05 for the coagulant concentration and pH, but it was more than 0.05 for flow rate (Table 2). This means that the concentration and pH factors had significant effects on the NOM, color, and turbidity removal. Moreover, based on the analysis of results, it was found that coagulant concentration and pH had the greatest effect on the NOM, color, and turbidity removal.

Conclusion

The results of this study have shown the applicability of the enhanced coagulation process and direct filtration in the treatment of surface water containing turbidity, color, and NOM in the intermediate pH. Using the enhanced coagulation treatment, pollutants are removed from water through direct reduction by $\text{Fe}(\text{OH})_2^+$ and $\text{Fe}(\text{OH})_3$, formed through the hydrolysis of FeCl_3 coagulant on the filtration media surface. By increasing the concentration of FeCl_3 , the amount of turbidity, color, and NOM removal efficiencies increased. Furthermore, according to the obtained results, high levels of input current leads to the reduction of pollutant removal because of the accumulation of flocs in pores of the filtration media. Hence the increase of input flow during enhanced coagulation and direct filtration did not have any significant effect on the removal of pollutants.

Acknowledgment

We would like to thank the following people for their support, without whose help this work would never have been possible.

References

1. Ebrahimi A, Taheri E, Pashae A, Mahdavi M. The effectiveness of polyaluminum ferric chloride (PAFCl) for turbidity and color removal from Isfahan raw water. *Desalin Water Treat* 2015 .55(7):1966-72.
2. Matilainen A. Removal of the natural organic matter in the different stage of the drinking water treatment process. Thesis for the degree of Ph.D. University of technology 2007; 4-5.

3. García I. Removal of Natural Organic Matter to reduce the presence of Trihalomethanes in drinking water. Thesis for the degree of Ph.D. School of Chemical Science and Engineering, Sweden 2011; 4-5.
4. Mamba BB, Krause RW, Matsebula B, Haarhoff J. Monitoring natural organic matter and disinfection by-products at different stages in two South African water treatment plants. *Water SA* 2009; 35(1):121-7.
5. Matilainen A, Vepsäläinen M, Sillanpää M. Natural organic matter removal by coagulation during drinking water treatment: a review. *Adv Colloid Interface Sci* 2010; 159(2):189-97.
6. McMeen CR, Benjamin MM. NOM removal by slow sand filtration through iron oxide-coated olivine. *J Am Water Works Assoc* 1997; 89(2):57-71.
7. Harrelkas F, Azizi A, Yaacoubi A, Benhammou A, Pons MN. Treatment of textile dye effluents using coagulation–flocculation coupled with membrane processes or adsorption on powdered activated carbon. *Desalination* 2009; 235(1-3):330-9.
8. Emamjomeh MM, Sivakumar M. Review of pollutants removed by electrocoagulation and electrocoagulation/flotation processes. *J EnvironManag.*2009;90(5):1663-79.
9. Siddiqui M. Membranes for the control of natural organic matter from surface waters. *Water Research* 2000; 34(13):3355-3370.
10. Matilainen A, Sillanpää M. Removal of natural organic matter from drinking water by advanced oxidation processes. *Chemosphere.* 2010; 80(4):351-65.
11. Eikebrokk B, Juhna T, Østerhus SW. Water treatment by enhanced coagulation–Operational status and optimization issues. *TECHNEAU, Deliverable Number D* 2006; 5(1).
12. Eikebrokk B. Coagulation-direct filtration of soft, low alkalinity humic waters. *WatSci Tech* 1999; 40(9):55-62.
13. Zouboulis A, Katsoyiannis I. Removal of arsenates from contaminated water by coagulation–direct filtration. *Sep SciTech* 2002; 37(12):2859-73.
14. Jaafarzadeh N, Mengelizadeh N, Jalil M, Takdastan A, Alavi N, Niknam N. Removal of zinc and nickel from aqueous solution by chitosan and polyaluminum chloride. *Int J Environ Health Eng.* 2016; 5(1):16.
15. Mesdaghinia A, Rafiee MT, Vaezi F, Mahvi A, Torabian A, Ghasri A. Control of disinfection by products formation potential by enhanced coagulation. *Int J Environ Sci Tech.* 2006;2(4):335-42.
16. Gregory J, Duan J. Hydrolyzing metal salts as coagulants. *Pure ApplChem.* 2001;73(12):2017-26.
17. Davis CC, Edwards M. Coagulation with hydrolyzing metal salts: mechanisms and water quality impacts. *Crit Rev Environ SciTechnol.* 2014; 44(4):303-47.
18. Sperczy ska E, D browska L, Wi niowska E. Removal of turbidity, colour and organic matter from surface water by coagulation with polyaluminium chlorides and with activated carbon as coagulant aid. *Desalin Water Treat.* 2016; 57(3):1139-44.
19. Tubi A, Agbaba J, Dalmacija B, Ivan ev-Tumbas I, Dalmacija M. Removal of arsenic and natural organic matter from groundwater using ferric and alum salts: a case study of central Banat region (Serbia). *J Environ Sci Health.* 2010;45(3):363-9.
20. Pang FM, Kumar P, Teng TT, Omar AM, Wasewar KL. Removal of lead, zinc and iron by coagulation–flocculation. *J Taiwan InstChemEng.* 2011; 42(5):809-15.
21. Bojic AL, BojicD, Andjelkovic T. Removal of Cu_{2+} and Zn_{2+} from model wastewaters by spontaneous reduction–coagulation process in flow conditions. *J Hazard Mater.* 2009; 168(2):813-9.